

HOT WORK PERMIT

After this is filled out and signed, send to _____
 for recordkeeping in the _____ file.

Type of work: _____

Permit is good for one shift only, or not to exceed the time limit. TIME LIMIT: _____ a.m.
 p.m.

Area: _____ Date: _____

Describe work to be done: _____

Note: Check Yes or No. If question does not apply, indicate it with N/A (not apply).

	YES	NO
1. Can this equipment be removed from the building?		
2. Have all process materials been removed from equipment?		
3. Have all connections been blanked off and switches been locked open?		
4. Has equipment been ventilated?		
5. Can sparks ignite material in vicinity lower level?		
6. Is the work area clear of all explosive, flammable, and hazardous material (35-ft. rule)?		
7. Is all combustible material removed from the work area or protected (35-ft. rule)?		
8. Has a fire watch been assessed?		
9. Is an operational fire extinguisher readily available?		
10. Has the nearest fire alarm pull station been located?		
11. Does the operator have the correct personal protective equipment (e.g., eye protection, gloves, face shield)?		
12. Is the area where the work will occur adequately ventilated?		
13. Have the dangers associated with the following been eliminated or specifically addressed?		
a) Penetrating a pressurized system?		
b) Penetrating a container of hazardous chemicals?		
c) Affecting an item that is potentially radioactive		
d) Damaging property?		


14. SPECIAL PRECAUTIONS TO BE OBSERVED: _____

I have personally inspected and approve conditions for above.

Signed: _____ Department: _____
(Operating Supervisor)

and/or Signed: _____ Time: _____ Date: _____
(Safety Department)

Example of the Hot Work 35-ft. (11m) Rule

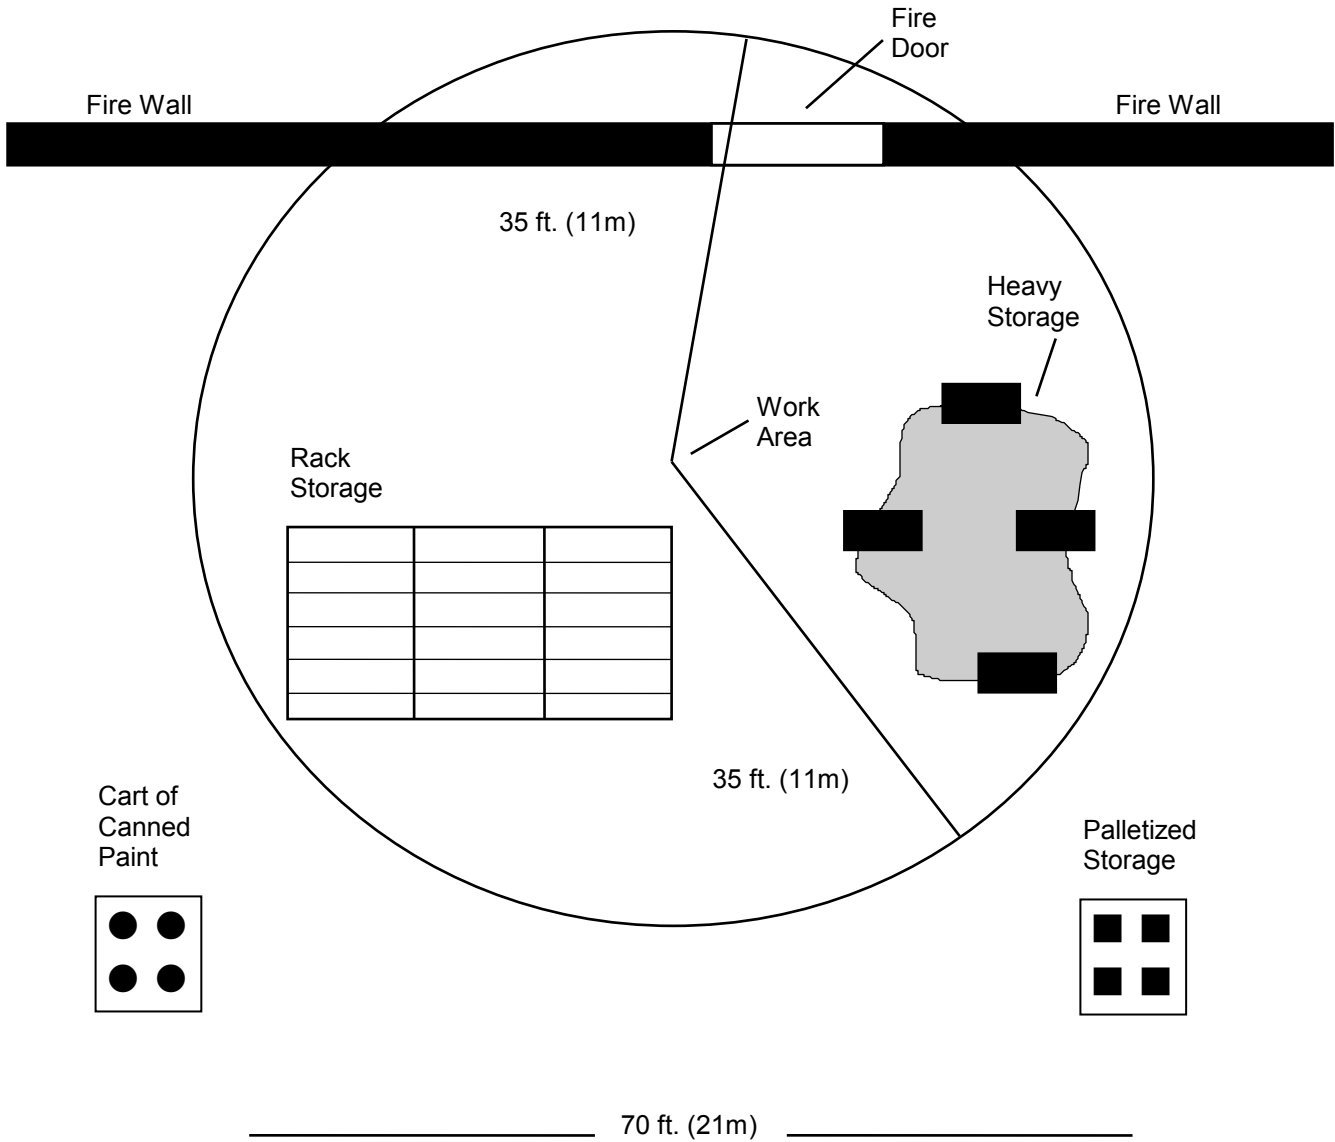

- Remove or shield from sparks all potential fuels within 35 ft. (11m) of the work area. In this case, the paint cart and palletized storage.
- Empty racks on which the work is to be done of all storage.
- Close fire doors and seal floor openings such as the area surrounding process piping with noncombustible caulking.
- Cover heavy combustible storage that is impractical to move with a fire-resistive material.